


****CAPSULE PAK™
LOCATION MAY VARY**

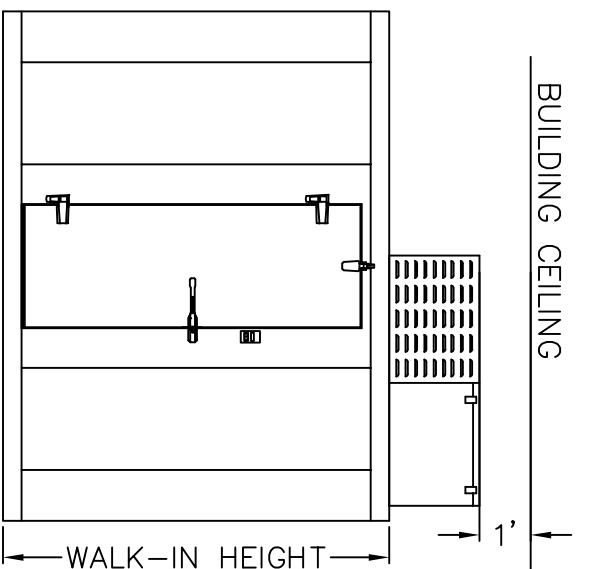

VIEW - A-

**One foot of clearance is needed between the top of the Capsule Pak™ refrigeration system and the building ceiling. Please refer to page 2 of the Capsule Pak™ specification sheet located on the Nor-Lake website for specific dimensions

WALK-IN HEIGHT

- 6'7" (WITH FLOOR)
- 7'4"** (LESS FLOOR) (STANDARD)
- 7'7"** (WITH FLOOR) (STANDARD)
- 8'4" (LESS FLOOR)
- 8'7" (WITH FLOOR)

REFRIGERATION TYPE

- CEILING CAPSULE PAK™** (STANDARD)
- REMOTE
- NONE

LOCATION

- INDOOR
- OUTDOOR

TEMPERATURE

- 35° F
- 10° F


DOOR SWING

- LEFT (SHOWN)
- RIGHT (DASHED)

DOOR OPENING WIDTH

- 26"** (STANDARD)
- 30"
- 36" (NOT AVAILABLE ON 6'7" HEIGHT)

AVAILABLE DOOR LOCATIONS (CHECK ONE)

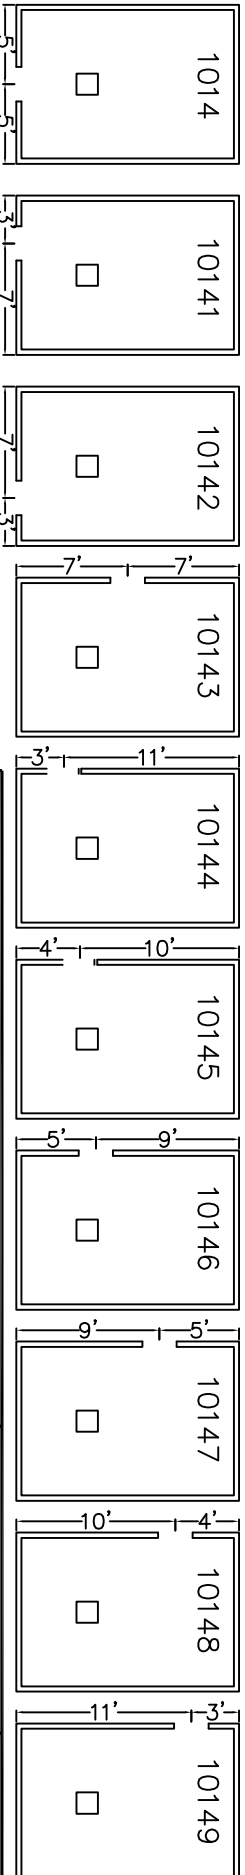

PLEASE RETURN THE APPROVED DRAWINGS AS SOON AS POSSIBLE TO PREVENT ANY DELAY IN FABRICATION.

- APPROVED
- APPROVED AS NOTED
- NOT APPROVED-RESUBMIT

SIGNED _____
DATE _____

IMPORTANT: AFTER THE PRINT APPROVAL CHANGES MADE ADDITIONAL CHARGES AND THE POSSIBILITY OF A REVISED SHIPPING DATE

REFRIGERATED SOLUTIONS GROUP		DRN BY: KB	APP BY:
DESCRIPTION: KOLD LOCKER/QUICK SHIP		DATE: 8/29/17	SC: NTS
SIZE: 10'0" x 14'0"		#: KL--1014	